

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

378

Dated:

1-01-2024

It is certified that an inspection team headed by SDE PANKAJ KAPOOR(Name of Officers with designation) from WATER SUPPLY & SANITATION(Name of Department/ Office) inspected the AKAL ACADEMY CHAK DESRAJ


(Name & Address of the school) on(date of inspection) and found that the AKAL ACADEMY CHAK DESRAJ (Name of school) has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

The above is valid for a period of 1 Year

Signature with Seal:

Name

Designation

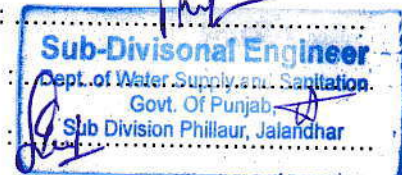

Name & Address of the Office / Department :

To

Akal Academy Chak DesrajEnglish medium day boarding
edu. public school

(Name & Address of the Institution)

* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.

Principal

Akal Academy Chak Desraj
Jalandhar

Manager

Akal Academy Chak Desraj
Jalandhar

DISTRICT WATER TESTING LABORATORY, JALANDHAR

Water Supply and Sanitation Office, Near Bara Dari, Near DC Office, Jalandhar
dwtl@jalandhar@gmail.com

TEST REPORT

Name & Address of Customer : Akal Academy, Chak Des Raj, Tehsil Phillaur, Distt. Jalandhar.	Customer Reference No.	No : 529 Dated : 05/03/2024
	Sample Submitted by	Ramandeep Kaur
	Date of Sample Receipt	07/03/2024
	Analysis Starting Date	12/03/2024
	Analysis completion Date	13/03/2024

Discipline : Chemical Testing		Group: Water	
ULR No.:		Sample Type :	Water
Test Report No.:	DWTJAL/2324/00540	Date of Issue :	13/03/2024
Registration no.:	DWTJAL/REG2324/00541	Condition of Sample :	Unsealed
Collection Point:	Private Submersible	Quantity/Type of Bottle:	1000 ml / Amber Coloured Sample Bottle - 500 mL.
Scheme/Source:	Not Mentioned(Not Mentioned)	Location/Depth :	Akal Academy Chak Des Raj (P/Sub.) / NA
Village :	Chak Des Raj	Habitation :	Chak Des Raj
Block:	Phillaur	District :	Jalandhar
Latitude :	Not Mentioned	Longitude:	Not Mentioned

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.26@24°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	470.0	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	Alkalinity	397.88	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	Hardness	294.88	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2019) EDTA Method
9	Calcium	73.08	75	200	mg/l	IS 3025 (Part 40-1991) EDTA Titrimetric Method
10	Magnesium	27.34	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride	19.71	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

Note: Detection Limit(Turbidity:0.5,)
 This Report is issued under the following terms & Condition :
 1. The results apply to the sample as received only.
 2. The sample will be destroyed after retention time unless otherwise specified specially.
 3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
 4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed), ND=Not Detected
 5. * Value not available or test not performed for this parameter.
 6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By




Mr. Jivesh Kumar
 Quality Manager
 Authorized Signatory
 For, District water Testing Laboratory
 Jalandhar



Principal

Akal Academy Chak Desraj
Jalandhar

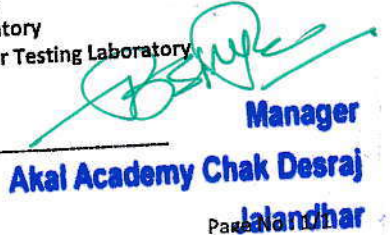

Manager
Akal Academy Chak Desraj
Jalandhar

End of the Test Report